


10KW 3 Phase Configuration - With Factor 1 Rule



Cerbo GX

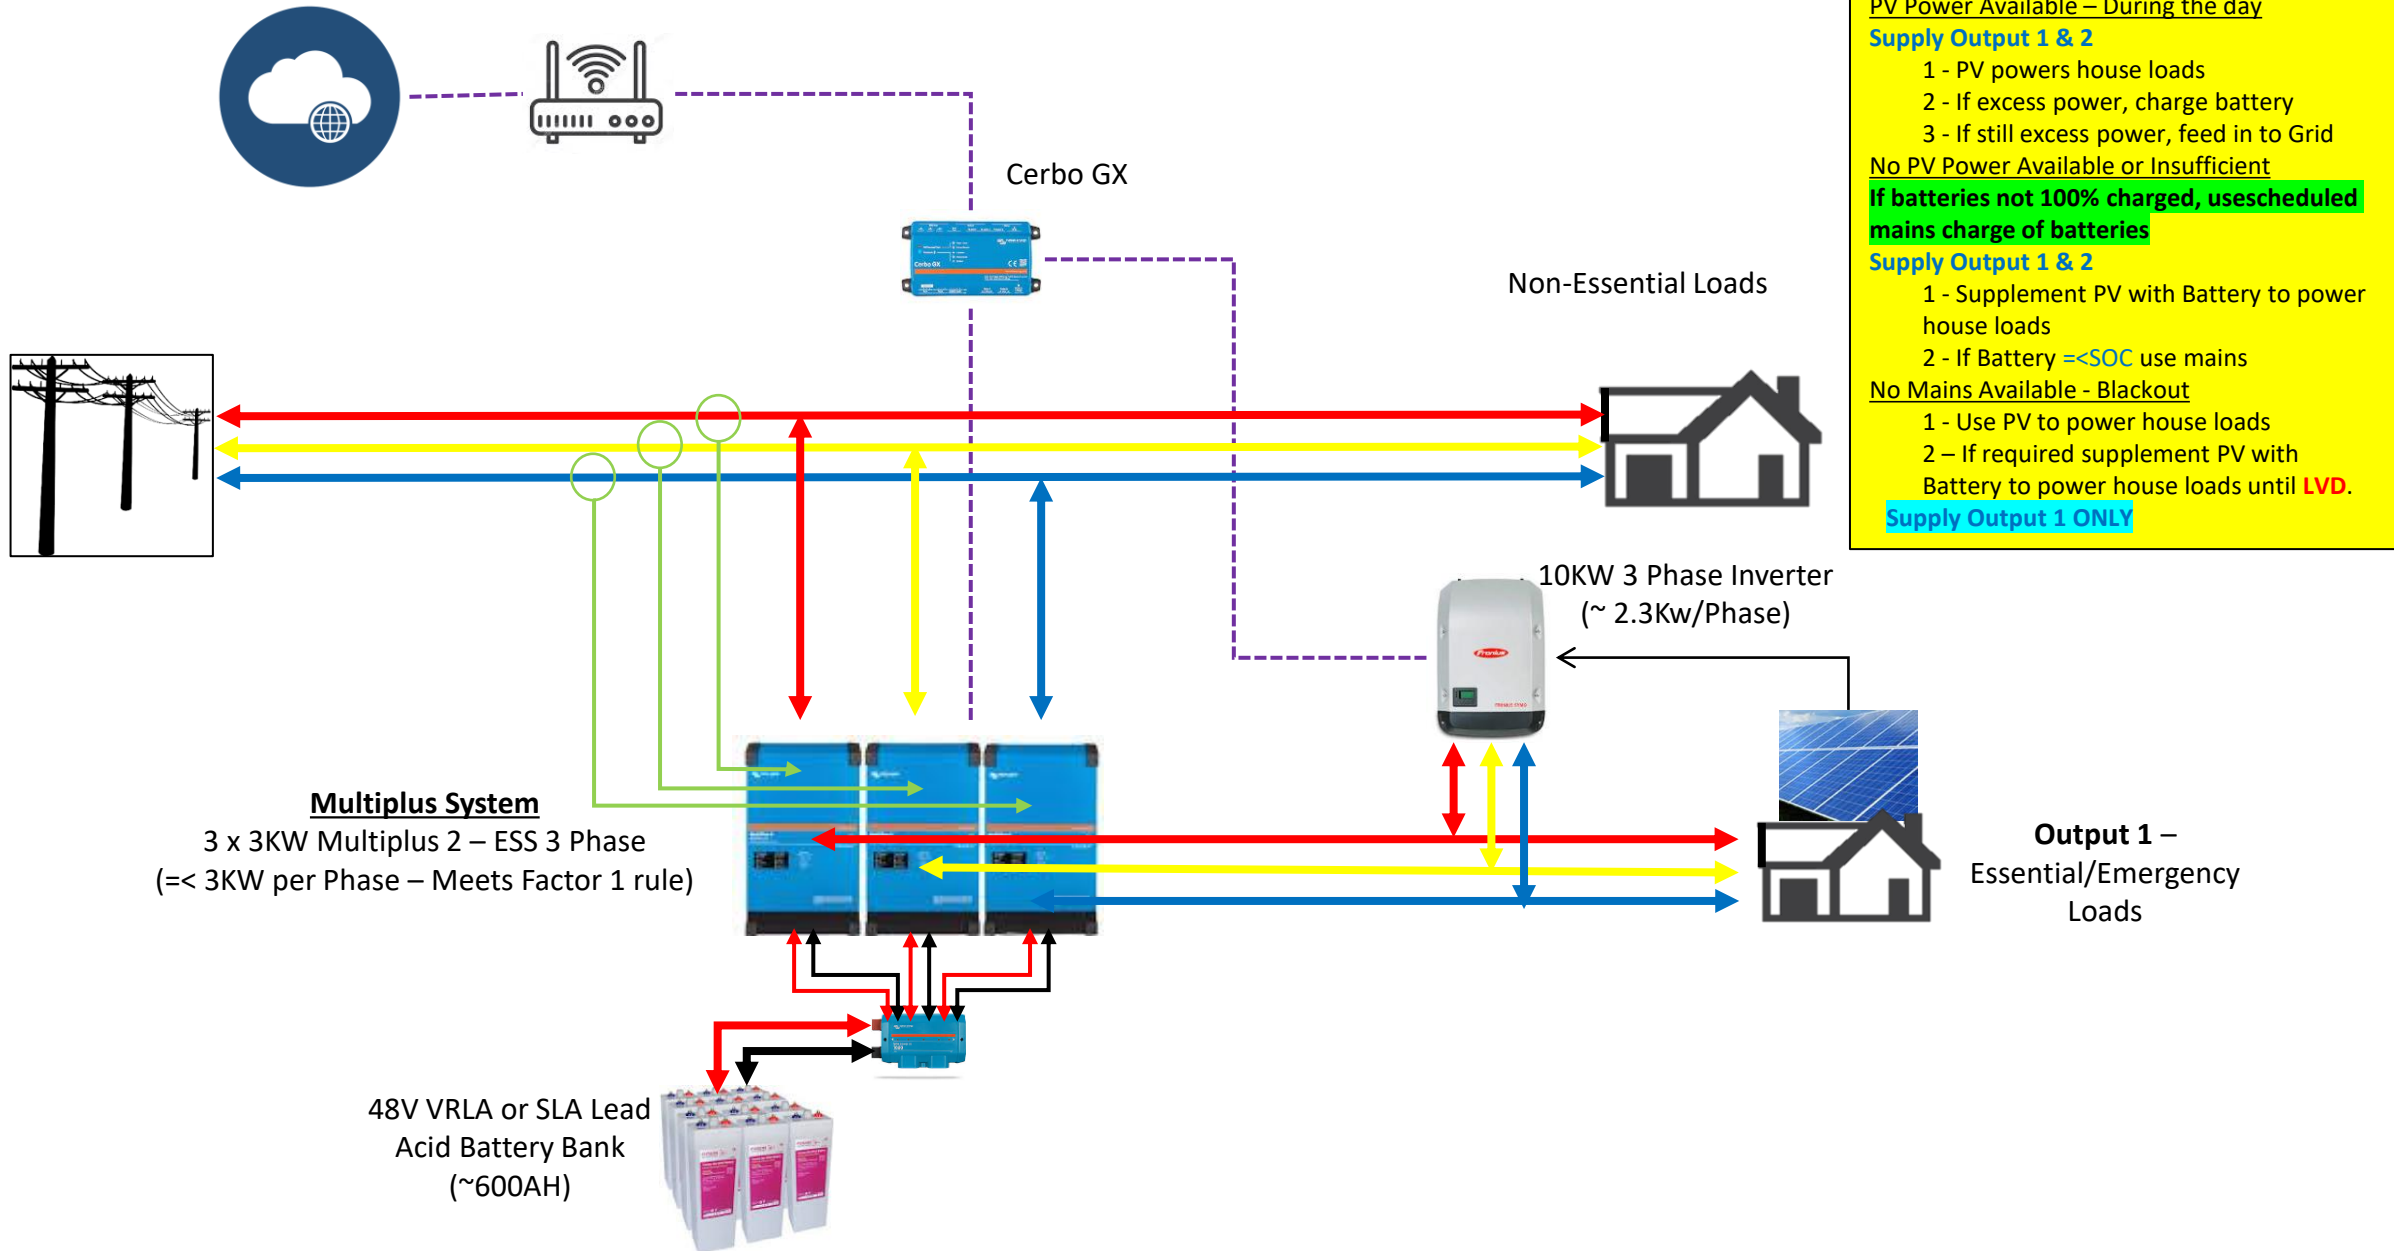

Non-Essential Loads




10KW 3 Phase Inverter (~ 2.3Kw/Phase)



Multiplus System

3 x 3KW Multiplus 2 – ESS 3 Phase
 (= < 3KW per Phase – Meets Factor 1 rule)

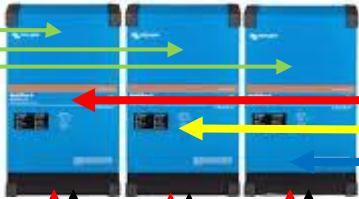

Output 1 –
 Essential/Emergency Loads



48V VRLA or SLA Lead Acid Battery Bank (~600AH)

